




# HALL A Pavilion 75A ITE

	No object (blue on the wall)
	Electrical supply (blue on the wall)
	Communication point
	Electrical supply (wall socket)
	Telephone point
	Fire alarm point (1st zone)
	Fire alarm point (2nd zone)
	Fire alarm point (3rd zone)
	Fire alarm point (4th zone)
	Fire alarm point (5th zone)
	Fire alarm point (6th zone)
	Fire alarm point (7th zone)
	Fire alarm point (8th zone)
	Fire alarm point (9th zone)
	Fire alarm point (10th zone)
	Fire alarm point (11th zone)
	Fire alarm point (12th zone)
	Fire alarm point (13th zone)
	Fire alarm point (14th zone)
	Fire alarm point (15th zone)
	Fire alarm point (16th zone)
	Fire alarm point (17th zone)
	Fire alarm point (18th zone)
	Fire alarm point (19th zone)
	Fire alarm point (20th zone)
	Fire alarm point (21st zone)
	Fire alarm point (22nd zone)
	Fire alarm point (23rd zone)
	Fire alarm point (24th zone)
	Fire alarm point (25th zone)
	Fire alarm point (26th zone)
	Fire alarm point (27th zone)
	Fire alarm point (28th zone)
	Fire alarm point (29th zone)
	Fire alarm point (30th zone)
	Fire alarm point (31st zone)
	Fire alarm point (32nd zone)
	Fire alarm point (33rd zone)
	Fire alarm point (34th zone)
	Fire alarm point (35th zone)
	Fire alarm point (36th zone)
	Fire alarm point (37th zone)
	Fire alarm point (38th zone)
	Fire alarm point (39th zone)
	Fire alarm point (40th zone)
	Fire alarm point (41st zone)
	Fire alarm point (42nd zone)
	Fire alarm point (43rd zone)
	Fire alarm point (44th zone)
	Fire alarm point (45th zone)
	Fire alarm point (46th zone)
	Fire alarm point (47th zone)
	Fire alarm point (48th zone)
	Fire alarm point (49th zone)
	Fire alarm point (50th zone)
	Fire alarm point (51st zone)
	Fire alarm point (52nd zone)
	Fire alarm point (53rd zone)
	Fire alarm point (54th zone)
	Fire alarm point (55th zone)
	Fire alarm point (56th zone)
	Fire alarm point (57th zone)
	Fire alarm point (58th zone)
	Fire alarm point (59th zone)
	Fire alarm point (60th zone)
	Fire alarm point (61st zone)
	Fire alarm point (62nd zone)
	Fire alarm point (63rd zone)
	Fire alarm point (64th zone)
	Fire alarm point (65th zone)
	Fire alarm point (66th zone)
	Fire alarm point (67th zone)
	Fire alarm point (68th zone)
	Fire alarm point (69th zone)
	Fire alarm point (70th zone)
	Fire alarm point (71st zone)
	Fire alarm point (72nd zone)
	Fire alarm point (73rd zone)
	Fire alarm point (74th zone)
	Fire alarm point (75th zone)
	Fire alarm point (76th zone)
	Fire alarm point (77th zone)
	Fire alarm point (78th zone)
	Fire alarm point (79th zone)
	Fire alarm point (80th zone)
	Fire alarm point (81st zone)
	Fire alarm point (82nd zone)
	Fire alarm point (83rd zone)
	Fire alarm point (84th zone)
	Fire alarm point (85th zone)
	Fire alarm point (86th zone)
	Fire alarm point (87th zone)
	Fire alarm point (88th zone)
	Fire alarm point (89th zone)
	Fire alarm point (90th zone)
	Fire alarm point (91st zone)
	Fire alarm point (92nd zone)
	Fire alarm point (93rd zone)
	Fire alarm point (94th zone)
	Fire alarm point (95th zone)
	Fire alarm point (96th zone)
	Fire alarm point (97th zone)
	Fire alarm point (98th zone)
	Fire alarm point (99th zone)
	Fire alarm point (100th zone)

**Ceiling Heights**  
Minimum 380cm  
Maximum 720cm

**Floor Loading**  
Maximum 10000kg/m<sup>2</sup>

**Area**  
Maximum 14700m<sup>2</sup>(br)

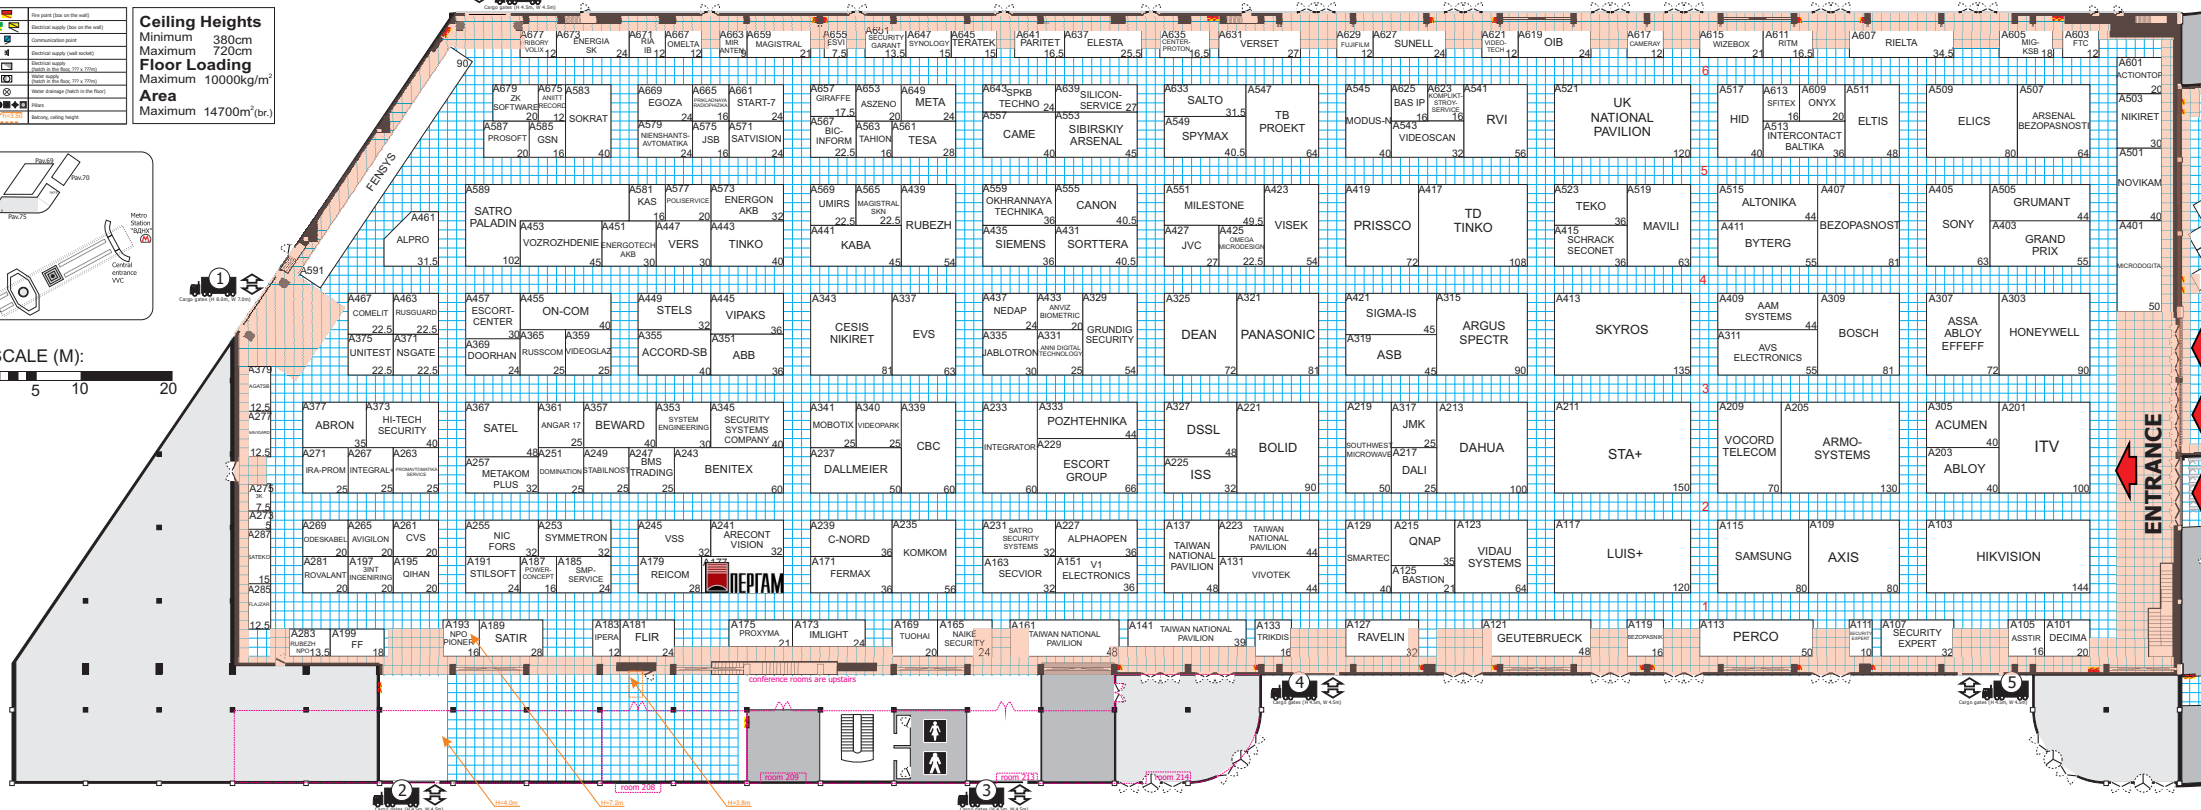

ВНИМАНИЕ! ОРГАНИЗАТОР ОСТАВЛЯЕТ ЗА СОБОЙ ПРАВО ИЗМЕНЯТЬ МЕСТОРАСПОЛОЖЕНИЕ КОМПАНИИ НА ПЛАНЕ В СЛУЧАЕ ТЕХНИЧЕСКОЙ НЕОБХОДИМОСТИ

С РАЗМЕЩЕНИЕМ И УСЛОВИЯМИ СОГЛАСЕН \_\_\_\_\_

ДАТА \_\_\_\_\_

М.П. \_\_\_\_\_